

Contactors, 4 pole, 500 A, 2 N/O, 2 NC, 220 V 50 Hz, 230 V 50 Hz, AC operation, Screw terminals



Part no. DILP500/22(220-230V50HZ)
Catalog No. 207463
Alternate Catalog No. XTCFA500N22F

Delivery program

| | | | |
|---|----------------|---|--|
| Product range | | | Contactors |
| Application | | | Contactors for 4 pole electric consumers |
| Subrange | | | Contactors larger than 200 A, 4 pole |
| Utilization category | | | AC-1: Non-inductive or slightly inductive loads, resistance furnaces |
| Connection technique | | | Screw terminals |
| Number of poles | | | 4 pole |
| Rated operational current | | | |
| AC-1 | | | |
| Conventional free air thermal current, 3 pole, 50 - 60 Hz | | | |
| Open | | | |
| at 40 °C | $I_{th} = I_e$ | A | 500 |
| at 55 °C | $I_{th} = I_e$ | A | 470 |
| at 60 °C | $I_{th} = I_e$ | A | 400 |
| Conventional free air thermal current, 1 pole | | | |
| open | I_{th} | A | 1400 |
| Contacts | | | |
| N/O = Normally open | | | 2 N/O |
| N/C = Normally closed | | | 2 NC |
| Contact sequence | | | |
| For use with | | | DILP800-XHI... |
| Actuating voltage | | | 220 V 50 Hz 230 V 50 Hz |
| Voltage AC/DC | | | AC operation |

Technical data

| | | | |
|---|--------------|---------------|--|
| General | | | |
| Standards | | | IEC/EN 60947, VDE 0660 |
| Lifespan, mechanical | | | |
| AC operated | Operations | $\times 10^6$ | 5 |
| Operating frequency, mechanical | | | |
| AC operated | Operations/h | | 3600 |
| Climatic proofing | | | Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature | | | |
| Open | | °C | -40 - +70 |
| Mounting position | | | |
| Mounting position | | | |
| Mechanical shock resistance (IEC/EN 60068-2-27) | | | |
| Half-sinusoidal shock, 15 ms | | | |
| Main contacts | | | |
| N/O contact | | g | 10 |
| Degree of Protection | | | IP00 |
| Protection against direct contact when actuated from front (EN 50274) | | | Finger and back-of-hand proof with terminal shroud |

| | | | |
|---|--|-----------------|----------------------------------|
| Terminal capacity main cable | | | |
| Solid | | mm ² | 1 x (70 - 300) 2 x (35 - 185) |
| Stranded | | mm ² | 1 x (70 - 300) 2 x (35 - 185) |
| Terminal capacity control circuit cables | | | |
| Solid | | mm ² | 2 x (0.5 - 2.5) |
| Main cable connection screw/bolt | | | |
| | | | M10 |
| Tightening torque | | | |
| | | Nm | 12 - 16 |
| Control circuit cable connection screw/bolt | | | |
| | | | M3.5 |
| Tightening torque | | | |
| | | Nm | 1.2 |
| Tool | | | |
| Control circuit cables | | | |
| Pozidriv screwdriver | | Size | 2 |

Main conducting paths

| | | | |
|---------------------------------------|-------------|------|-----------------------------------|
| Rated impulse withstand voltage | U_{imp} | V AC | 8000 |
| Overvoltage category/pollution degree | | | |
| | | | III/3 |
| Rated insulation voltage | U_i | V AC | 1000 |
| Rated operational voltage | U_e | V AC | 1000 |
| Safe isolation to EN 61140 | | | |
| between coil and contacts | | V AC | 1000 |
| between the contacts | | V AC | 690 |
| Making capacity (cos ϕ) | Up to 690 V | A | 5000 According to IEC/EN 60947 |
| Breaking capacity | | | |
| 220 V 230 V | | A | 5000 |
| 380 V 400 V | | A | 5000 |
| 500 V | | A | 5000 |
| 660 V 690 V | | A | 5000 |
| Short-circuit rating | | | |
| Short-circuit protection maximum fuse | | | |
| Type "2" coordination | | | |
| 400 V | gG/gL 500 V | A | 630 |
| Type "1" coordination | | | |
| 400 V | gG/gL 500 V | A | 630 |

AC

| | | | |
|---|----------------|-----|------|
| AC-1 | | | |
| Rated operational current | | | |
| Conventional free air thermal current, 3 pole, 50 - 60 Hz | | | |
| Open | | | |
| at 40 °C | $I_{th} = I_e$ | A | 500 |
| at 55 °C | $I_{th} = I_e$ | A | 470 |
| at 60 °C | $I_{th} = I_e$ | A | 400 |
| Conventional free air thermal current, 1 pole | | | |
| open | I_{th} | A | 1400 |
| AC-3 | | | |
| Rated operational current | | | |
| Open, 3-pole: 50 – 60 Hz | | | |
| 220 V 230 V | I_e | A | 400 |
| 240 V | I_e | A | 400 |
| 415 V | I_e | A | 400 |
| 440V | I_e | A | 400 |
| 500 V | I_e | A | 370 |
| 660 V 690 V | I_e | A | 370 |
| 1000 V | I_e | A | 155 |
| Motor rating | P | kWh | |

| | | | |
|-------------|---|----|-----|
| 220 V 230 V | P | kW | 110 |
| 240V | P | kW | 110 |
| 380 V 400 V | P | kW | 200 |
| 415 V | P | kW | 200 |
| 440 V | P | kW | 200 |
| 660 V 690 V | P | kW | 355 |
| 1000 V | P | kW | 220 |

DC

| | | | |
|---------------------------------|-------|---|-----|
| Rated operational current, open | | | |
| DC-1 | | | |
| 60 V | I_e | A | 370 |
| 110 V | I_e | A | 370 |
| 220 V | I_e | A | 370 |
| 440 V | I_e | A | 370 |
| DC-3 | | | |
| 60 V | I_e | A | 450 |
| 110 V | I_e | A | 450 |
| 220 V | I_e | A | 450 |
| 440 V | I_e | A | 450 |
| DC-5 | | | |
| 60 V | I_e | A | 450 |
| 110 V | I_e | A | 450 |
| 220 V | I_e | A | 450 |
| 440 V | I_e | A | 450 |

Current heat loss

| | | | |
|---------------------|--|---|-----|
| 4 pole, at I_{th} | | W | 145 |
|---------------------|--|---|-----|

Magnet systems

| | | | |
|--|---------|---------|------|
| Voltage tolerance | | | |
| AC operated | Pick-up | $x U_c$ | |
| Min. pick-up voltage, AC operated | | $x U_c$ | 0.85 |
| Pick-up voltage AC operated, max. | | $x U_c$ | 1.1 |
| Power consumption of the coil in a cold state and $1.0 \times U_S$ | | | |
| Dual-frequency coil 50/60 Hz | Pick-up | VA | 3500 |
| Dual-frequency coil 60 Hz | Sealing | VA | 140 |
| Dual-frequency coil 50/60 Hz | Sealing | W | 60 |
| Duty factor | | % DF | 100 |
| Changeover time at 100 % U_S (recommended value) | | | |
| Main contacts | | | |
| AC operated | | | |
| Closing delay | | ms | |
| Switching times of main contacts AC operated Closing delay, min. | | ms | 30 |
| Switching times of main contacts AC operated Closing delay, max. | | ms | 60 |
| Opening delay | | ms | |
| Switching times of main contacts AC operated Opening delay, min. | | ms | 10 |
| Switching times of main contacts AC operated Opening delay, max. | | ms | 20 |

Design verification as per IEC/EN 61439

| | | | |
|--|------------|----|-------|
| Technical data for design verification | | | |
| Rated operational current for specified heat dissipation | I_n | A | 500 |
| Heat dissipation per pole, current-dependent | P_{vid} | W | 36.25 |
| Equipment heat dissipation, current-dependent | P_{vid} | W | 0 |
| Static heat dissipation, non-current-dependent | P_{vs} | W | 60 |
| Heat dissipation capacity | P_{diss} | W | 0 |
| Operating ambient temperature min. | | °C | -40 |

| | | |
|--|----|--|
| Operating ambient temperature max. | °C | 70 |
| IEC/EN 61439 design verification | | |
| 10.2 Strength of materials and parts | | |
| 10.2.2 Corrosion resistance | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | Meets the product standard's requirements. |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | | Meets the product standard's requirements. |
| 10.2.5 Lifting | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | | Is the panel builder's responsibility. |
| 10.9 Insulation properties | | |
| 10.9.2 Power-frequency electric strength | | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | | Is the panel builder's responsibility. |
| 10.10 Temperature rise | | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.12 Electromagnetic compatibility | | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.13 Mechanical function | | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |


Technical data ETIM 7.0

| | | |
|---|----|-----------------|
| Low-voltage industrial components (EG000017) / Power contactor, AC switching (EC000066) | | |
| Electric engineering, automation, process control engineering / Low-voltage switch technology / Contactor (LV) / Power contactor, AC switching (ecl@ss10.0.1-27-37-10-03 [AAB718015]) | | |
| Rated control supply voltage Us at AC 50HZ | V | 220 - 230 |
| Rated control supply voltage Us at AC 60HZ | V | 0 - 0 |
| Rated control supply voltage Us at DC | V | 0 - 0 |
| Voltage type for actuating | | AC |
| Rated operation current Ie at AC-1, 400 V | A | 500 |
| Rated operation current Ie at AC-3, 400 V | A | 400 |
| Rated operation power at AC-3, 400 V | kW | 200 |
| Rated operation current Ie at AC-4, 400 V | A | 0 |
| Rated operation power at AC-4, 400 V | kW | 0 |
| Rated operation power NEMA | kW | 0 |
| Modular version | | No |
| Number of auxiliary contacts as normally open contact | | 2 |
| Number of auxiliary contacts as normally closed contact | | 2 |
| Type of electrical connection of main circuit | | Rail connection |
| Number of normally closed contacts as main contact | | 0 |
| Number of main contacts as normally open contact | | 4 |

Approvals

| | | |
|-----------------------------|--|---|
| Product Standards | | IEC/EN 60947-4-1; UL 508; CSA-C22.2 No. 14-05; CE marking |
| UL File No. | | E29096 |
| UL Category Control No. | | NLDX |
| CSA File No. | | LR72236 |
| North America Certification | | UL listed, CSA certified |

Dimensions

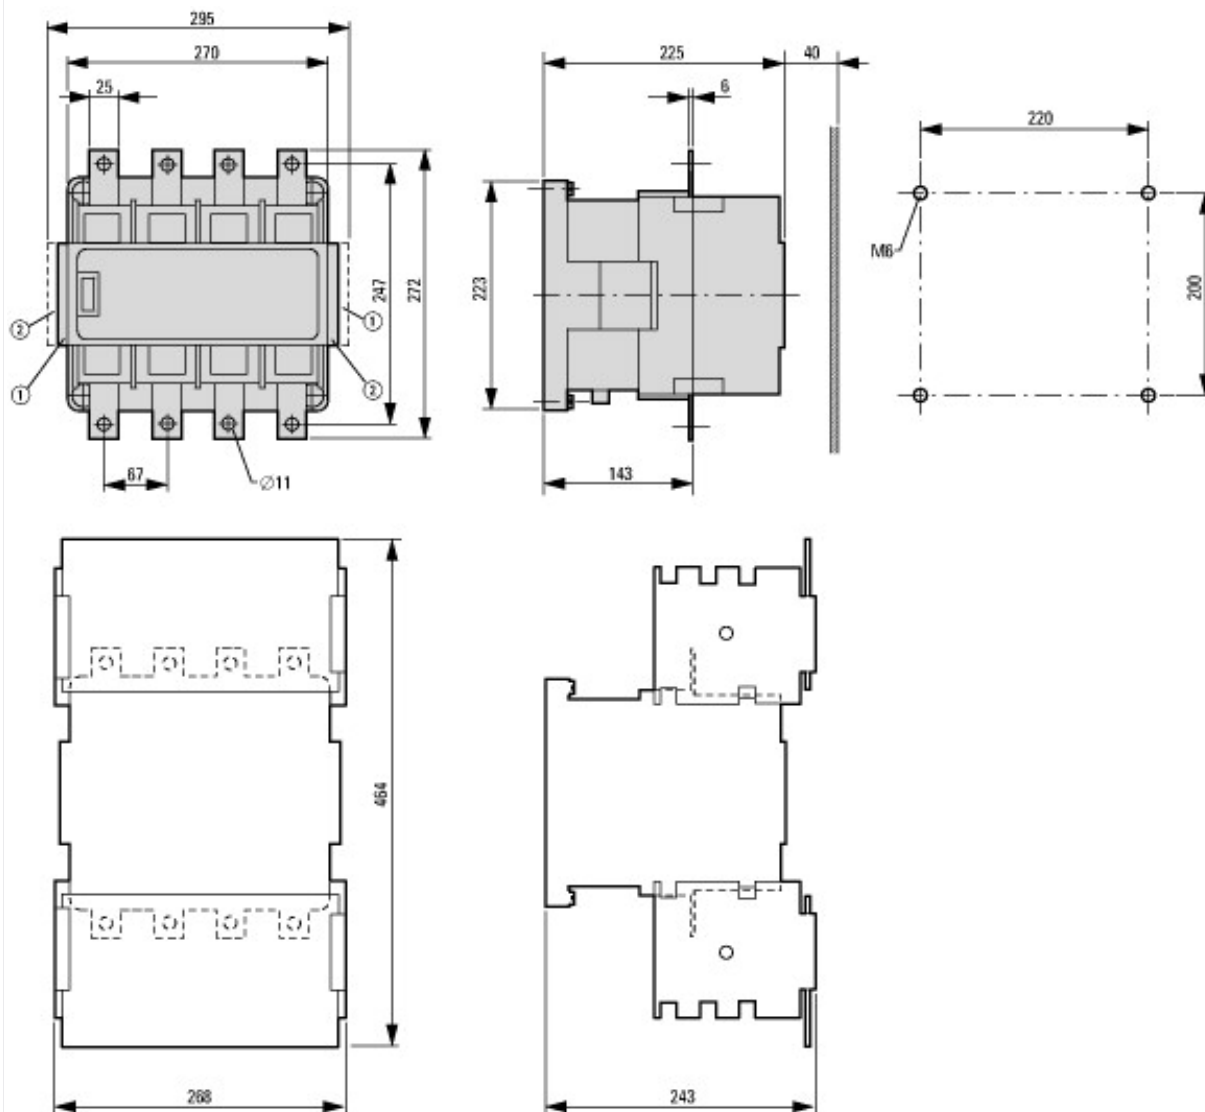

- ① DILP800-XHI-SI
 ② DILP800-XHI11-SA

DILP500 + DILP800-XHB

Additional product information (links)

| | |
|--|---|
| Motor starters and "Special Purpose Ratings" for the North American market | http://www.eaton.eu/ecm/groups/public/@pub/@europe/@electrical/documents/content/pct_3258146.pdf |
| Switchgear of Power Factor Correction Systems | http://www.moeller.net/binary/ver_techpapers/ver934en.pdf |
| X-Start - Modern Switching Installations Efficiently Fitted and Wired Securely | http://www.moeller.net/binary/ver_techpapers/ver938en.pdf |
| Mirror Contacts for Highly-Reliable Information Relating to Safety-Related Control Functions | http://www.moeller.net/binary/ver_techpapers/ver944en.pdf |
| Effect of the Cable Capacitance of Long Control Cables on the Actuation of Contactors | http://www.moeller.net/binary/ver_techpapers/ver949en.pdf |
| Switchgear for Luminaires | http://www.moeller.net/binary/ver_techpapers/ver955en.pdf |
| Standard Compliant and Functionally Safe Engineering Design with Mechanical Auxiliary Contacts | http://www.moeller.net/binary/ver_techpapers/ver956en.pdf |
| The Interaction of Contactors with PLCs | http://www.moeller.net/binary/ver_techpapers/ver957en.pdf |
| Busbar Component Adapters for modern Industrial control panels | http://www.moeller.net/binary/ver_techpapers/ver960en.pdf |